

AE1/AP-2F

cylindrical inductive




Micro Detectors

Italian Sensors Technology



Indicative image

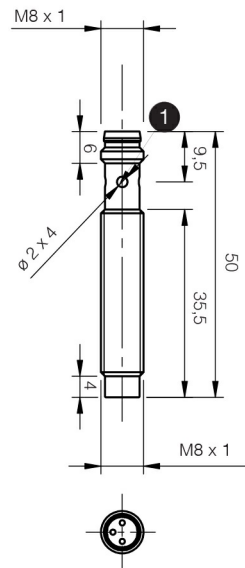

Detection properties

| | |
|--------------------------|--|
| Nominal sensing distance | 2,5mm |
| Operanting distance | 0...2,02mm |
| Standard target | 8x8mm FE360 |
| Correction Factor | copper: 0,43 / aluminium: 0,51 / brass: 0,59 / stainless steel: 0,83 |
| Thermal drift of Sr | < 10% |
| Repeat Accuracy | 5% (UB 24V Ta=23°C ±5°C) |
| Hysteresis | 1 ... 20% |

Outputs

| | |
|---------------------|------|
| Output type | PNP |
| Output Function | NO |
| Switching frequency | 5kHz |

Electrical data

| | |
|------------------------------------|-------------------------|
| Operating Voltage | 10...30Vdc |
| No-Load supply current | ≤ 10mA |
| Load current | ≤ 200mA |
| Leakage current | ≤ 10μA |
| Output voltage drop | ≤ 1,8V @200mA |
| Max ripple content | ≤10% |
| LED indicators | Yellow LED output state |
| Time delay before availability | 50ms |
| Short-circuit protection | Yes |
| Reverse Polarity Protection | Yes |
| Protection against inductive loads | Yes |

Mechanical data

| | |
|-----------------------|---------------------|
| Mounting | Unshielded |
| Dimensions | M8 x 1 / L = 50mm |
| Weight | 20g |
| Housing Material | Nickel-plated brass |
| Connections | M8 Plug |
| Active Head Material | PBT |
| Tightening torque | 3Nm |
| Operating temperature | -25°C...+70°C |

Test/Approvals

| | |
|-----------------------|--|
| Approvals | CE UR |
| EMC compatibility | IEC 60947-5-2 |
| Shocks and vibrations | Vibration IEC 60068-2-6 / Shock IEC 60068-2-27 |
| Degree of protection | IP67 |

Accessories

| | |
|----------------------|-------------|
| Supplied Accessories | 2 nuts M8x1 |
|----------------------|-------------|


ELECTRICAL DIAGRAMS OF THE CONNECTIONS



CONNECTOR




INSTALLATION

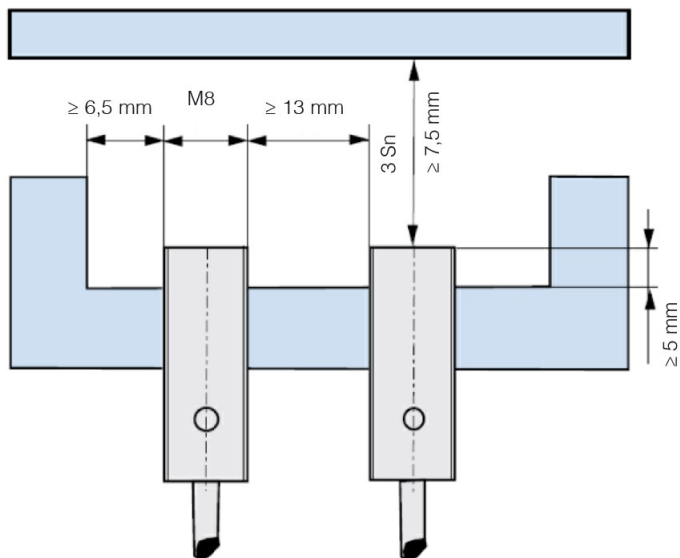

RESPONSE CURVES

Disassamento Parallelo

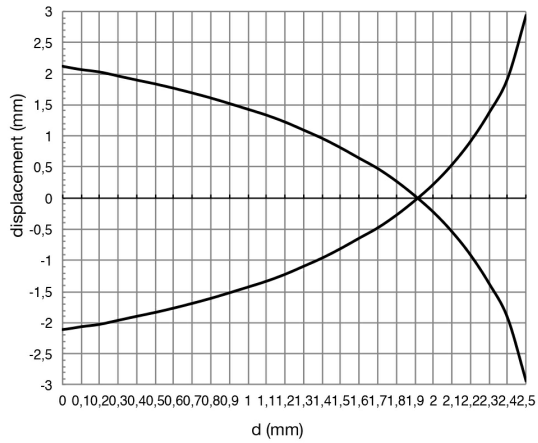

M.D. Micro Detectors S.p.A.

Strada S. Caterina, 235

41122 Modena (MO)

Tel. 059 420411

Fax 059 253973

E-mail info@microdetectors.com

date of printing

13/05/2020 13:41:21